


HIGH LOW MANIFOLD SYSTEM

ECO-MIX™

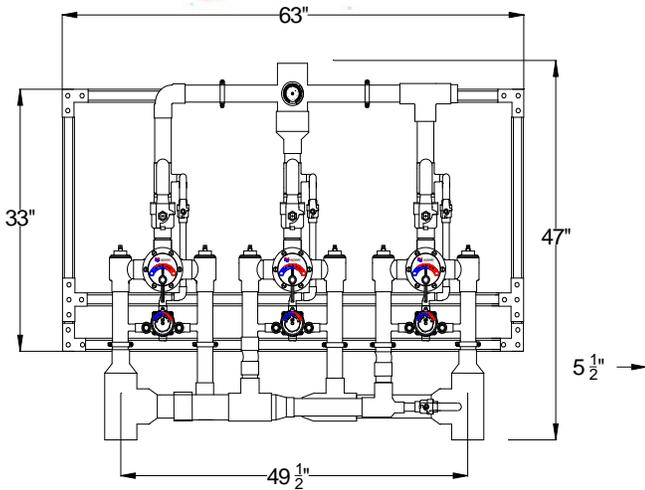

TM-2020B-3PS-LF _____ PARALLEL INSTALLATION WITH STRUT

- Large Type TM Thermostatic water mixing valves, adjustable high temperature limit stop*, inlet checkstops, wall support, outlet ball valve.
- Small Type TM Thermostatic water mixing valves, adjustable high temperature limit stop*, integral checkstops, outlet ball valve.
- 4" inlets, 4" outlet (102mm X 102mm)
- Maximum operating pressure: 125 PSI (860 KPA)
- Locking temperature regulators
- 3 GPM (11.4 l/min) minimum flow capacity
- Inlet/Outlet manifold piping
- Dial thermometer on outlet
- Mounted on galvanized strut
- Factory assembled and tested

This product is certified to meet Low Lead requirements of wetted surface area containing less than 0.25% lead by weight

Valve assembly is ASSE 1017 Certified



Valve assemblies are CSA B125.3-12 Certified



OPTIONS

- ___ SUFFIX TC- Test connection (ship loose)
- ___ SUFFIX IT- Inlet thermometers (ship loose)

See page #2 for piping diagram


Note: Leonard Valve Company reserves the right of product, or design modifications without notice or obligation.



WARNING: This product can expose you to chemicals including lead, which is known to the State of California to cause cancer. For more information, go to www.P65Warnings.Ca.gov

<p>CAUTION! All thermostatic water mixing valves have limitations. They will NOT provide the desired accuracy outside of their flow capacity range. Consult the Flow Capacity Chart and DO NOT OVERSIZE. Minimum flow must be no less than as indicated.</p>		<p>*NOTE: A limit stop, set for 120°F (49°C), is simply a mechanical setting to prevent excessive handle rotation. If incoming water is hotter than 150°F (65.5°C), the temperature of the factory test, the valve when turned to full HOT may deliver water in excess of 120°F and the limit stop MUST BE RESET BY THE INSTALLER</p>
<p>Engineer's Approval</p>	<p>Job # _____</p> <p>Arch/Eng. _____</p> <p>Contractor _____</p>	<p>Product is non-cancellable and non-returnable from date from order with factory. Signed submittal required with purchase order.</p>
<p>Note: The models shown represent Leonard Products which are believed to be equivalent in type and function to items specified. Leonard Valve Company is not responsible for errors or omissions due to differences in interpretations of information provided.</p>		<p>LEONARD[®] WATER TEMPERATURE CONTROLS</p> <p>1360 Elmwood Avenue, Cranston, RI 02910 USA Phone: 401.461.1200 Fax: 401.941.5310 Email: info@leonardvalve.com Web Site: http://www.leonardvalve.com</p>

REQUIRED PIPING METHOD #5

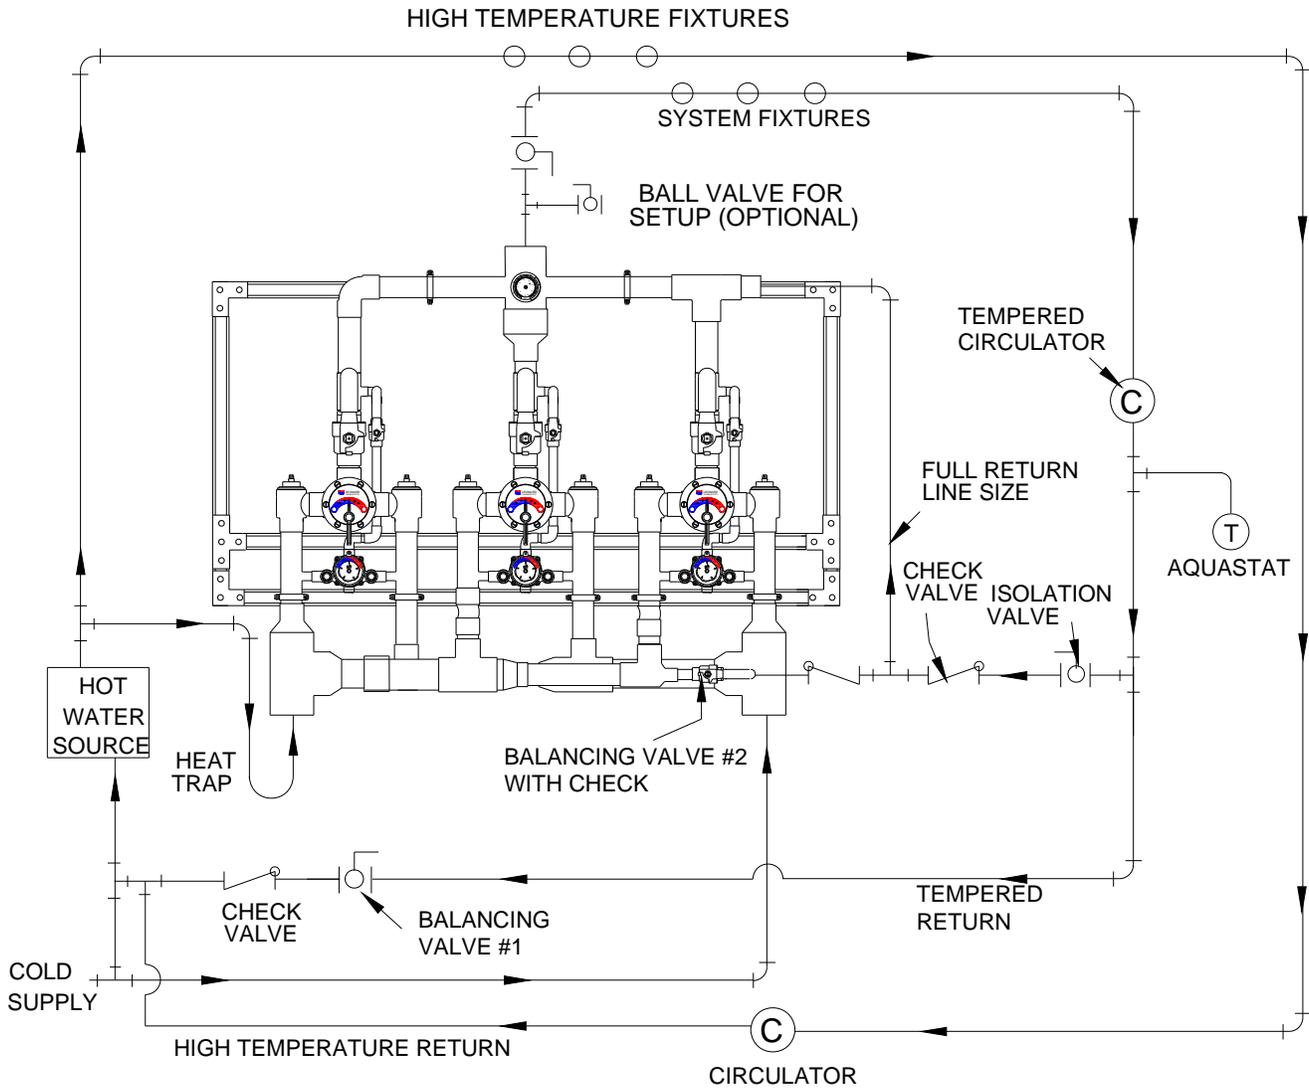

TRIPLE FLOWRATE WHEN ALL VALVES ARE OPERATING

SINGLE VALVE ASSEMBLY FLOWRATES SHOWN
(MINIMUM FLOW RATE HAS BEEN TRIPLED TO 3 GPM)

MINIMUM FLOW (GPM)	SYSTEM PRESSURE DROP (PSIG)										PSI
	5	10	15	20	25	30	35	40	45	50	
(l/min)	.3	.7	.97	1.4	1.7	2.1	2.4	2.8	3.1	3.4	BAR
3.0	78	113	129	145	163	172	188	197	214	226	GPM
(11.4)	295	428	488	549	617	651	712	746	810	856	l/min



1360 Elmwood Avenue, Cranston, RI 02910 USA

Phone: 401.461.1200 Fax: 401.941.5310

Email: info@leonardvalve.com

Web Site: <http://www.leonardvalve.com>